
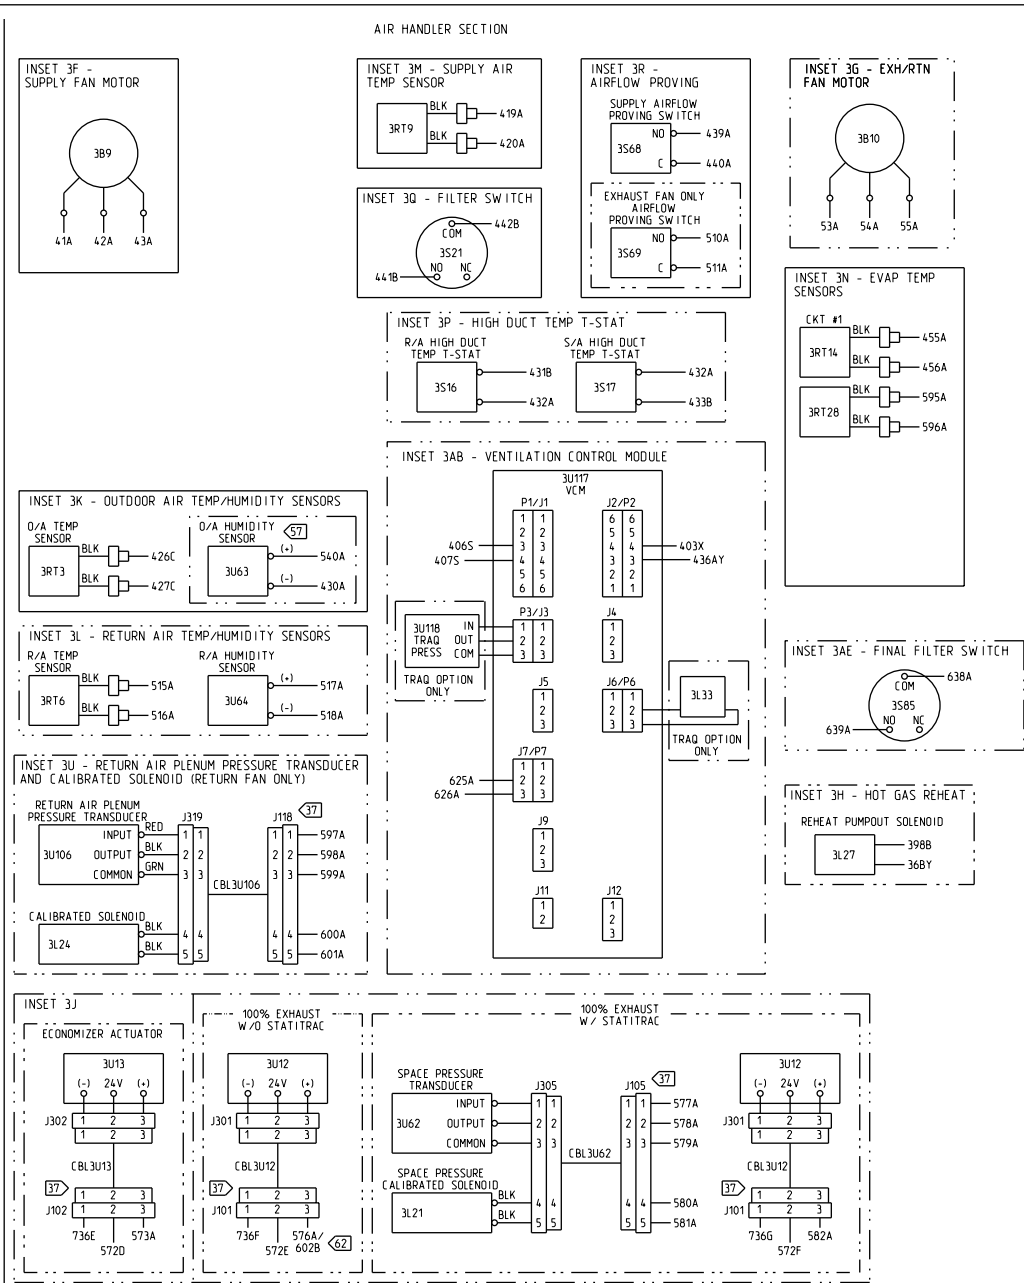


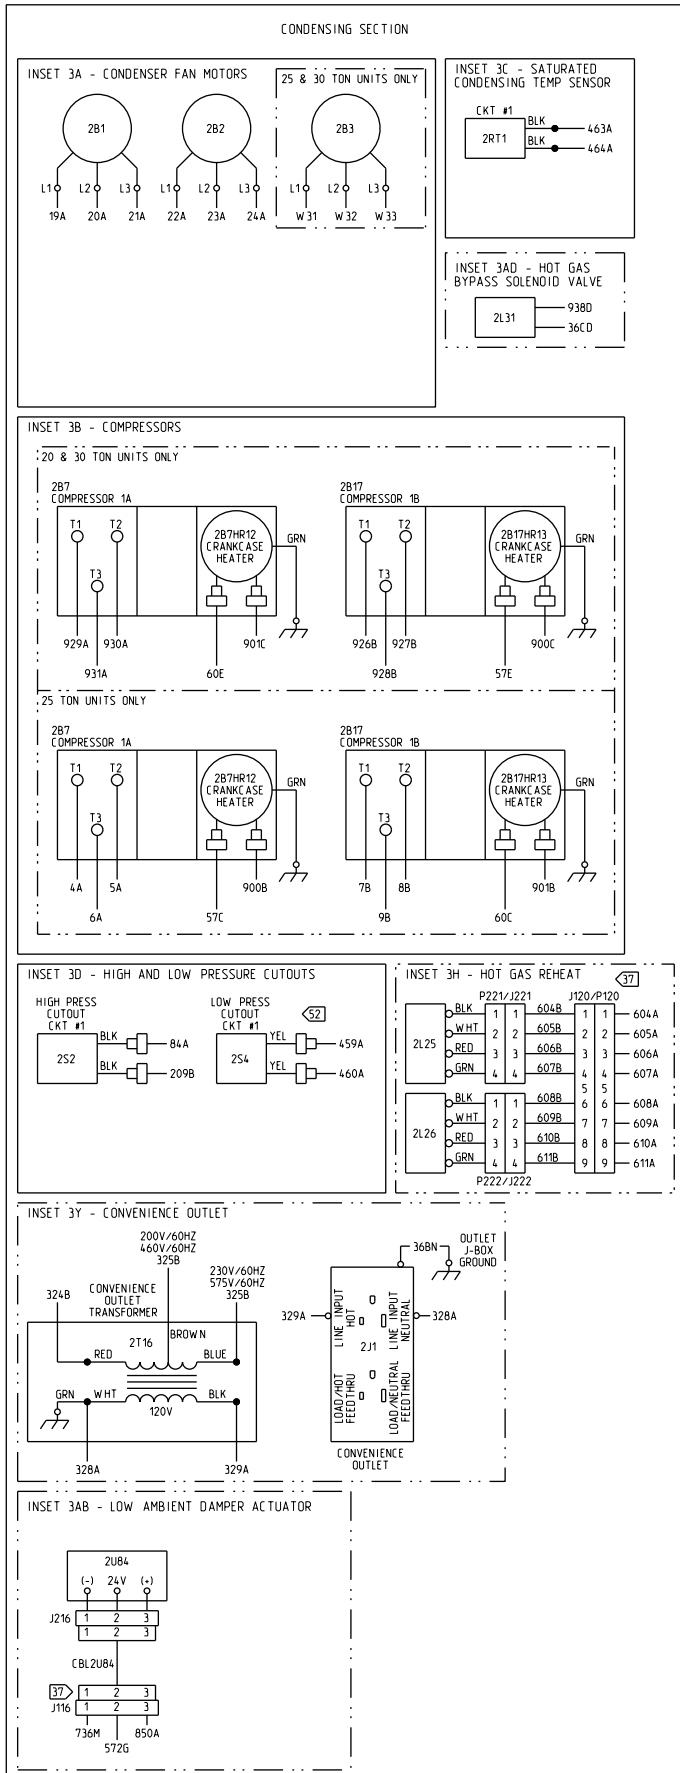

TRANE

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO ANY OTHER PARTIES WITHOUT THE CONSENT OF TRANE.

DRAWN BY: K. EDWARDS

REPLACES: 2313-1015A

CAD SYSTEM USED: Pro/DETAIL

FILE NUMBER: 2313-1923

DRAWING NUMBER: 2313-1924

SHEET: 1 OF 1

REV: B

ROOFTOP PACKAGED AIR CONDITIONER

DIAGRAM

CONNECTION - RACEWAY DEVICES

RT 20-30 TON STANDARD

CONNECTION 3 OF 3

AREA	LOCATION
1	INSIDE UNIT CONTROL BOX
2	CONDENSER SECTION
3	AIR HANDLER SECTION
4	HEATING SECTION
5	EXTERNAL FIELD MOUNTED DEVICE

NOTES:

37 PLUGS J101, J102, J105, J116, J118 AND J120 LOCATED IN MAIN CONTROL PANEL.

52 254 IS A LOW PRESSURE CUTOUT SWITCH USED FOR COMPRESSOR PROTECTION (25 PSIG). CAUTION !! DO NOT JUMPER ACROSS SWITCH UNDER ANY CIRCUMSTANCE.

57 3U63 AND ASSOCIATED WIRING USED ON REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY OPTIONS.

62 WIRE 576A USED ONLY ON UNITS WITH OPTIONAL EXHAUST FAN WITHOUT STATITRAC. WIRE 602B USED ONLY ON UNITS WITH OPTIONAL RETURN FAN WITHOUT STATITRAC.

