

H

G

F

E




D

C





B

A

LEGEND		
DEVICE DESIGNATION	DESCRIPTION	LINE NUMBER
AH	HEAT CONTACTOR - CIRCUIT A	10,11,23
BH	HEAT CONTACTOR - CIRCUIT B	14,15,25
CC1	COMPRESSOR CONTACTOR	6-8
CH	HEAT CONTACTOR CIRCUIT C	18,19,24
FU3-FU5	UNIT FUSE	6-8
FU6-FU8	ELECTRIC HEAT FUSE	10-12
FU9-FU11	ELECTRIC HEAT FUSE	14-16
FU12-FU14	EH FUSE	18-20
HTB2	HIGH VOLTAGE TERMINAL BLOCK	3
HTRA	ELECTRIC HEAT ELEMENT	10-12
HTRB	ELECTRIC HEAT ELEMENT	14-16
HTRC	ELECTRIC HEAT ELEMENT	18-20
PPF6	ELECTRIC HEAT PLUG (FEMALE)	23-30
PPM6	ELECTRIC HEAT PLUG (MALE)	23-30
TCOA	THERMAL CUTOUT - AUTO RESET	23
TCOB	THERMAL CUTOUT - AUTO RESET	25

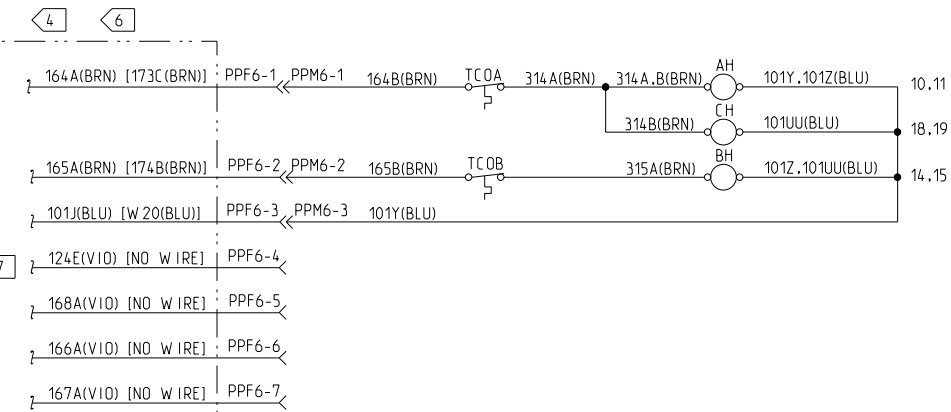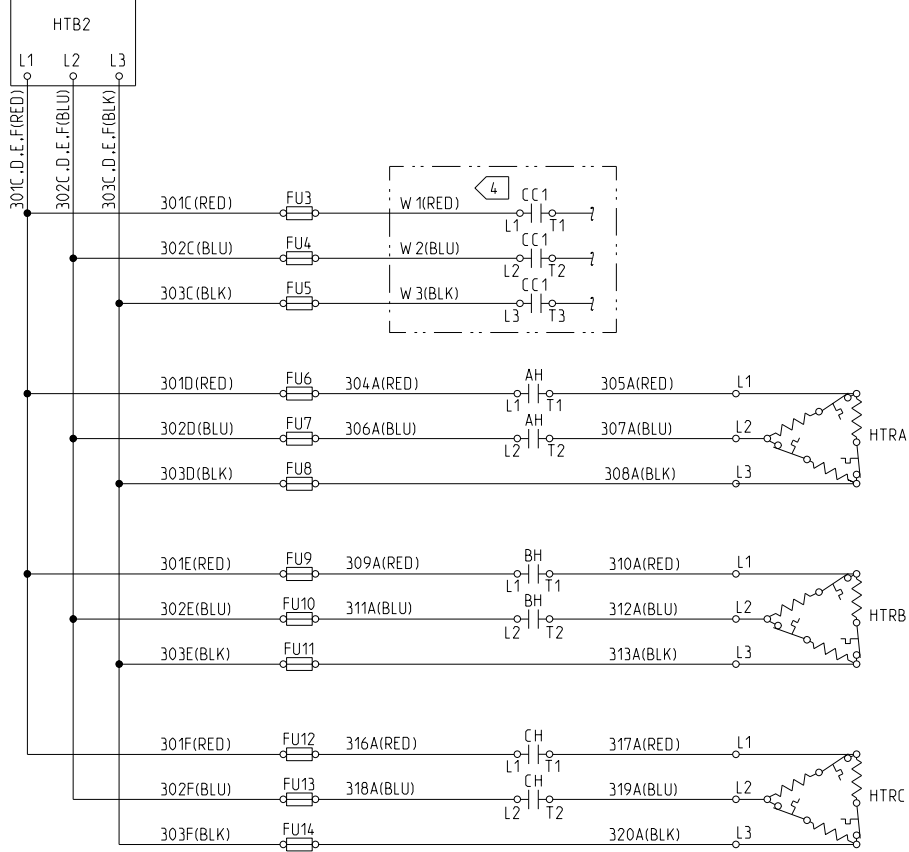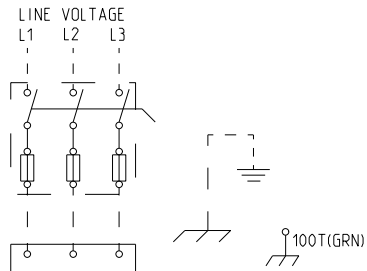

1. UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25° C (77° F) AT ATMOSPHERIC PRESSURE, AT 50% RELATIVE HUMIDITY WITH ALL UTILITIES TURNED OFF AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
2. DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS.
- NUMBERS ALONG THE RIGHT SIDE OF THE SCHEMATIC DESIGNATE THE LOCATION OF CONTACTS BY LINE NUMBER. AN UNDERLINED NUMBER INDICATES A NORMALLY CLOSED CONTACT.
- 4 FOR SINGLE POINT POWER, UNCOIL WIRES W1(RED), W2(BLU), AND W3(BLK) AND ROUTE THROUGH BUSHING IN DIVIDER PANEL. UP THROUGH HOLE IN UNIT CONTROL BOX, AND CONNECT TO COMPRESSOR CONTACTOR. (CC1 TERMINALS L1, L2, AND L3. PPF6/PPM6 AND ASSOCIATED WIRING ARE PART OF THE UNIT.)
- 5 CONNECT WIRE 100T(GRN) TO DIVIDER PANEL FOR BONDING.
- 6 CONNECTIONS SHOWN ARE FOR RELIATEL UNITS. WIRES FOR ELECTRO-MECHANICAL UNITS ARE SHOWN IN BRACKETS.
- 7 WIRE 131A(VIO) REPLACES WIRE 124E(VIO) ON 10 TON HEAT PUMP UNITS.

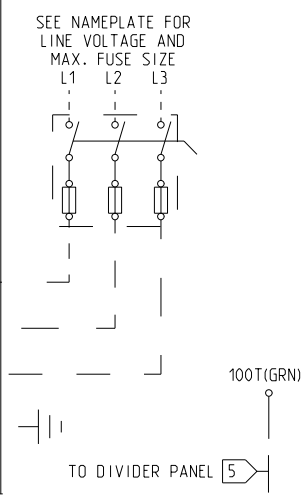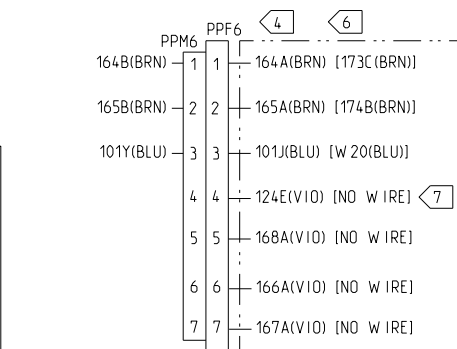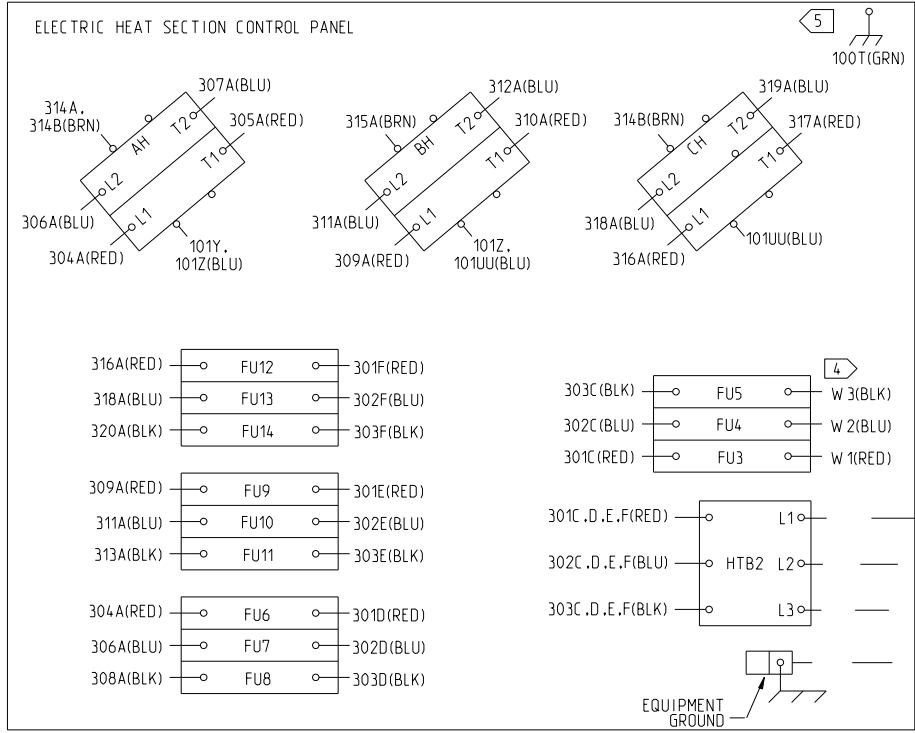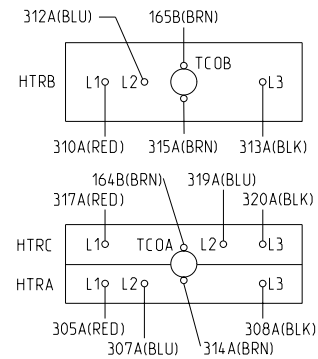

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES - TOLERANCE:
.X ± 0.1
.XX ± 0.03
.XXX ± 0.005
ANGLES ± 2.0 ° HOLE DIA ± .1
(CONFORMS TO ASME Y14.5M-1994.)

TRANE
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.
DRAWN BY: J.W. Wooley
DO NOT SCALE PRINT

4366-1086
SHEET 1 OF 1
DIAGRAM
ELECTRIC HEAT - 54 KW
240V/60Hz/3Ph
(T.W. 120)

REV D

WARNING
HAZARDOUS VOLTAGE!
DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS AND FOLLOW LOCK OUT AND TAG PROCEDURES BEFORE SERVICING. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITS WITH VARIABLE SPEED DRIVE. REFER TO DRIVE INSTRUCTIONS FOR CAPACITOR DISCHARGE.
FAILURE TO DO THE ABOVE COULD RESULT IN DEATH OR SERIOUS INJURY.

AVERTISSEMENT
TENSION DANGEREUSE!
COUPER TOUTES LES TENSIONS ET OUVRIR LES SECTIONNEURS A DISTANCE, PUIS SUIVRE LES PROCÉDURES DE VERROUILLAGE ET DES ÉTIQUETTES AVANT TOUTE INTERVENTION. VÉRIFIER QUE TOUTS LES CONDENSATEURS DES MOTEURS SONT DÉCHARGÉS. DANS LE CAS D'UNITÉS COMPORTANT DES ENTRAÎNEMENTS À VITESSE VARIABLE, SE REPORTER AUX INSTRUCTIONS DE L'ENTRAÎNEMENT POUR DÉCHARGER LES CONDENSATEURS.

IMPORTANT
DO NOT ENERGIZE UNIT UNTIL CHECK-OUT AND START-UP PROCEDURE HAS BEEN COMPLETED.

CAUTION
USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS. FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

FUSE REPLACEMENT TABLE			
ELECTRIC HEAT FUSES			
HEATER SIZE	FUSE NAME	FUSE CLASS	FUSE SIZE
54KW . 208/240V	FU6-FU14	T,300V	60A
UNIT FUSES FU3-FU5			
UNIT CAPACITY, VOLTS	HEATER MODEL SERIES	FUSE CLASS	FUSE SIZE
120. 208/230V	BAYHTRT354	RK5, 300V	70A