
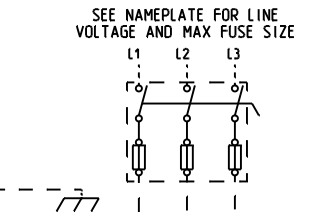
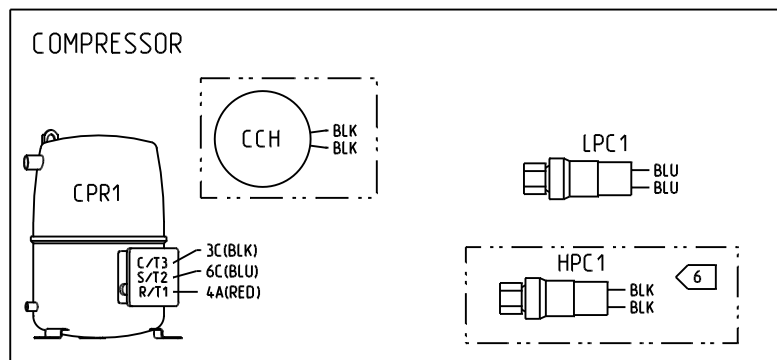
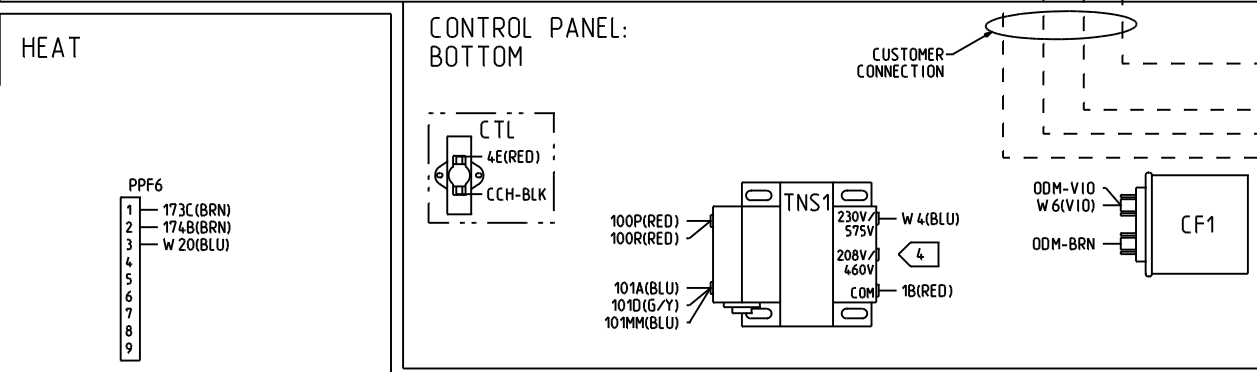


- | | |
|--|---|
| <p>⚠ WARNING
HAZARDOUS VOLTAGE!</p> <p>DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS AND FOLLOW LOCK OUT AND TAG PROCEDURES BEFORE SERVICING. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITS WITH VARIABLE SPEED DRIVE, REFER TO DRIVE INSTRUCTIONS FOR CAPACITOR DISCHARGE.</p> <p>FAILURE TO DO THE ABOVE COULD RESULT IN DEATH OR SERIOUS INJURY.</p> | <p>⚠ AVERTISSEMENT
TENSION DANGEREUSE!</p> <p>COUPER TOUTES LES TENSIONS ET OUVRIR LES SECTIONNEURS À DISTANCE. PUIS SUIVRE LES PROCÉDURES DE VERROUILLAGE ET DES ÉTIQUETTES AVANT TOUTE INTERVENTION. VÉRIFIER QUE TOUTS LES CONDENSATEURS DES MOTEURS SONT DÉCHARGÉS. DANS LE CAS D'UNITÉS COMPORTANT DES ENTRAÎNEMENTS À VITESSE VARIABLE, SE REPORTER AUX INSTRUCTIONS DE L'ENTRAÎNEMENT POUR DÉCHARGER LES CONDENSATEURS.</p> <p>NE PAS RESPECTER CES MESURES DE PRÉCAUTION PEUT ENTRAÎNER DES BLESSURES GRAVES POUVANT ÊTRE MORTELLES.</p> |
|--|---|

4366-1507	REV H
DIAGRAM CONNECTION PRINT - COOL ONLY, 3 TON, 3PH PWR, EM CNTL, DD IDM	

CAUTION
USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED TO
ACCEPT OTHER TYPES OF CONDUCTORS.
FAILURE TO DO SO MAY CAUSE DAMAGE
TO THE EQUIPMENT.

IMPORTANT
DO NOT ENERGIZE UNIT UNTIL
CHECK-OUT AND START-UP
PROCEDURE HAS BEEN COMPLETED.

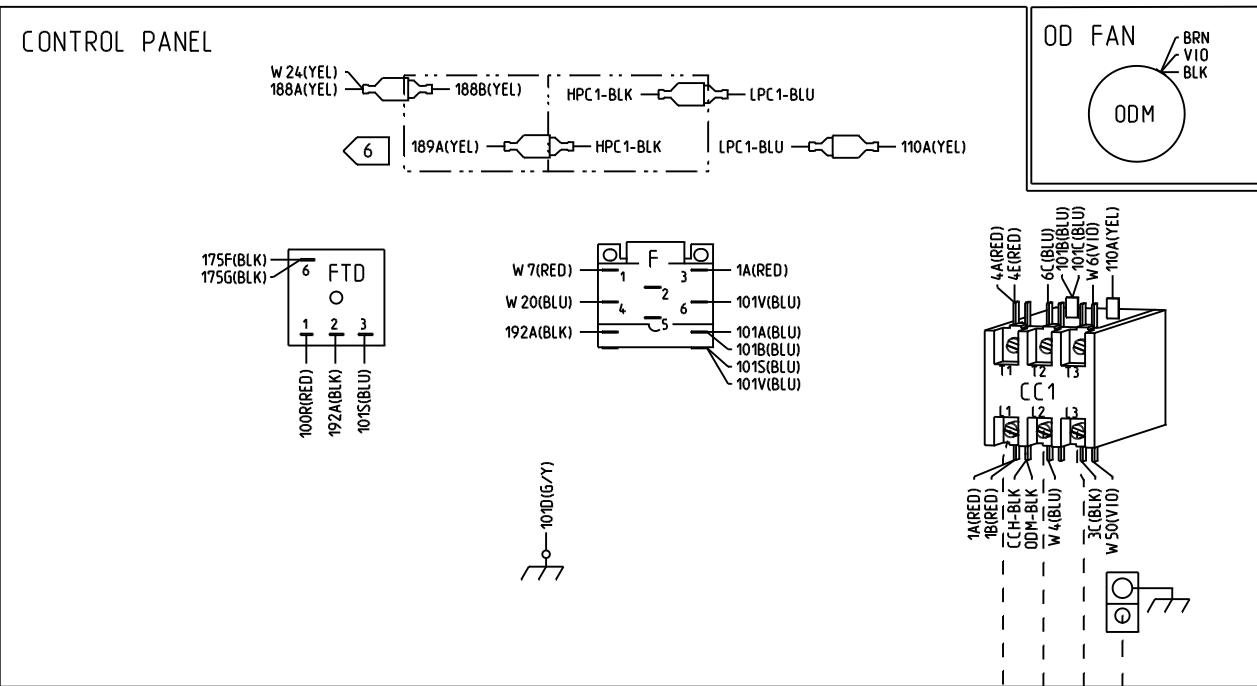

THERMOSTAT

100P(RED)	--RC
173C(BRN)	--W 1
174B(BRN)	--W 2
175G(BLK)	--G
	--RH
176D(YEL)	--Y 1
184A(YEL)	--Y 2
101MM(BLU)	--COMMON