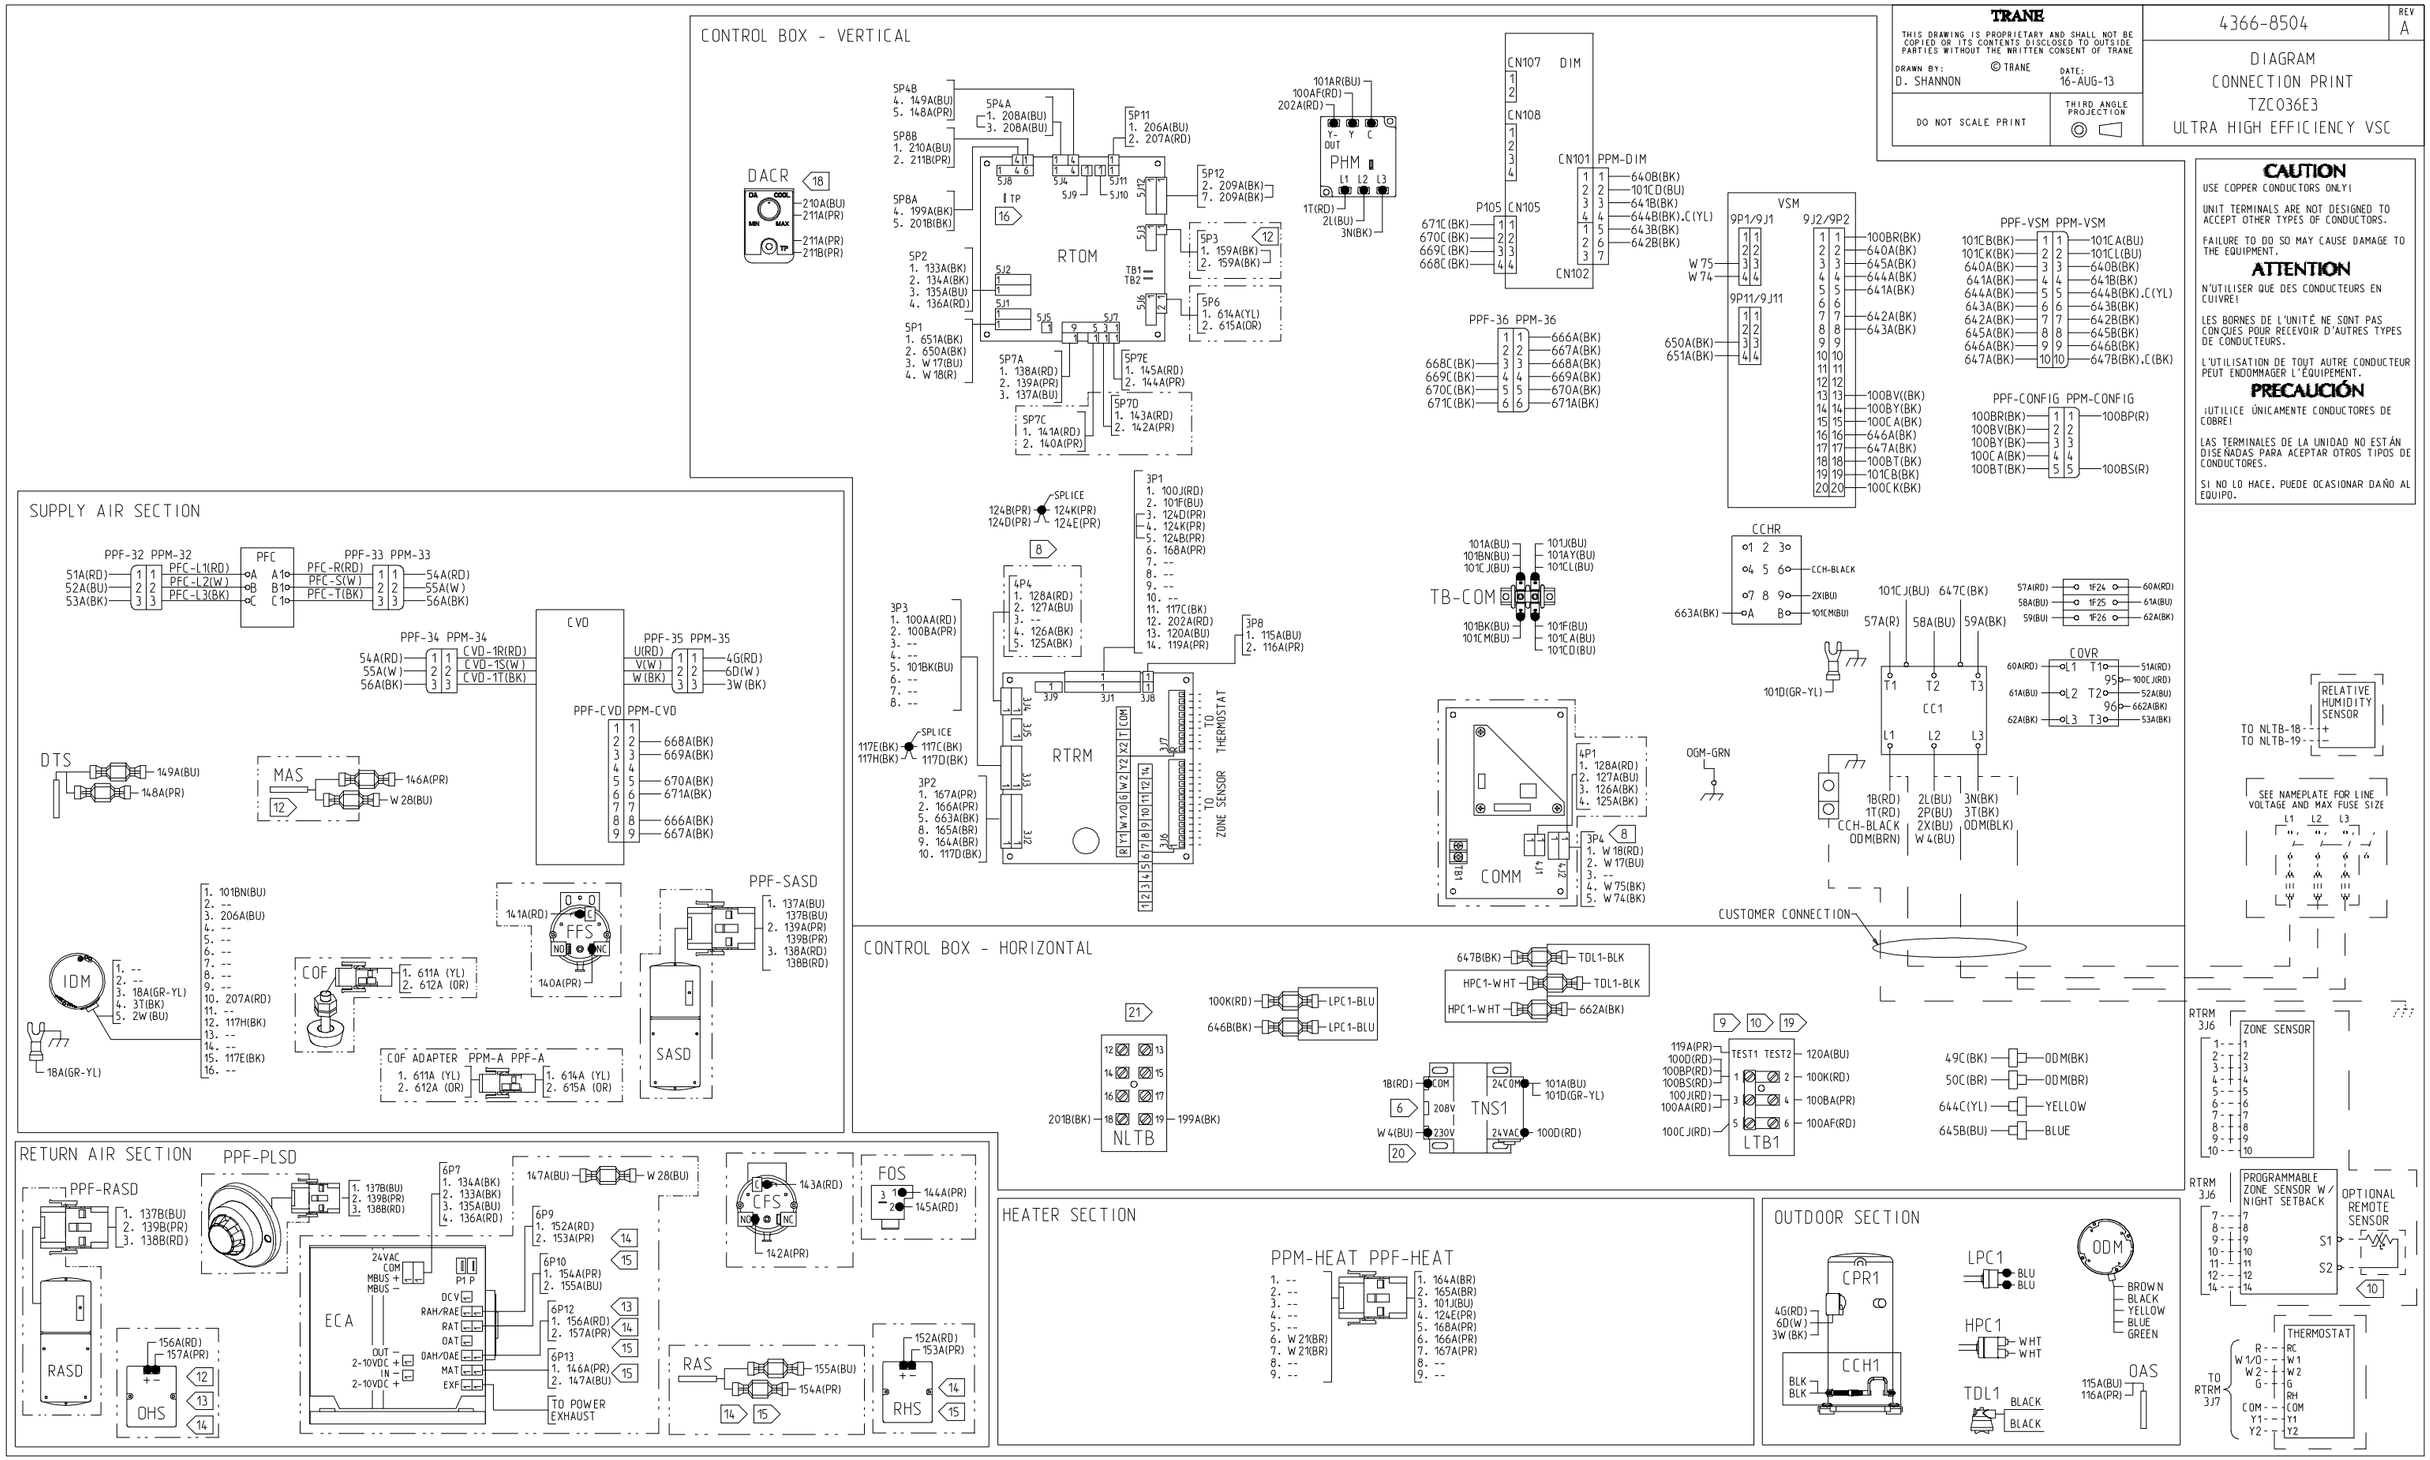
TRANE
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE
© TRANE
DRAWN BY: D. SHANNON
DATE: 16-AUG-13
DO NOT SCALE PRINT
THIRD ANGLE PROJECTION
4366-8504
REV A
DIAGRAM
CONNECTION PRINT
TZC036E3
ULTRA HIGH EFFICIENCY VSC
CAUTION
USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.
FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.
ATTENTION
N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!
LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.
L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'ÉQUIPEMENT.
PRECAUCIÓN
¡UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!
LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.
SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.
CONTROL BOX - VERTICAL
DACR
RTOM
PHM
CN107 DIM
CN108
CN101 PPM-DIM
CN102
P105 CN105
VSM
9P1/9J1
9J2/9P2
9P11/9J11
PPF-VSM PPM-VSM
PPF-36 PPM-36
PPF-CONFIG PPM-CONFIG
SUPPLY AIR SECTION
PPF-32 PPM-32
PFC
PPF-33 PPM-33
PPF-34 PPM-34
CVD
PPF-35 PPM-35
PPF-CVD PPM-CVD
DTS
MAS
IDM
COF
FFS
PPF-SASD
SASD
COF ADAPTER PPM-A PPF-A
SPLICE
RTRM
TO THERMOSTAT
TO ZONE SENSOR
TB-COM
CCHR
CCH-BLACK
COMM
CC1
COVR
CUSTOMER CONNECTION
RELATIVE HUMIDITY SENSOR
TO NLTB-18
TO NLTB-19
SEE NAMEPLATE FOR LINE VOLTAGE AND MAX FUSE SIZE
CONTROL BOX - HORIZONTAL
NLTB
TNS1
LTB1
ZONE SENSOR
PROGRAMMABLE ZONE SENSOR W/ NIGHT SETBACK
OPTIONAL REMOTE SENSOR
THERMOSTAT
RETURN AIR SECTION
PPF-RASD
RASD
PPF-PLSD
ECA
TO POWER EXHAUST
OHS
CFS
FOS
RAS
RHS
HEATER SECTION
PPM-HEAT PPF-HEAT
OUTDOOR SECTION
CPR1
CCH1
LPC1
HPC1
TDL1
ODM
OAS