

Installer's Guide

Isolator Kit BAYISLT101 (Six Per Pack)

⚠ WARNING: HAZARDOUS VOLTAGE - DISCONNECT POWER and DISCHARGE CAPACITORS BEFORE SERVICING

ALL phases of this installation must comply with NATIONAL, STATE AND LOCAL CODES

IMPORTANT— This Document is customer property and is to remain with this unit. Please return to service information pack upon completion of work.


General:



These instructions do not cover all variations in systems or provide for every possible contingency. Should further information be desired or particular problems arise which are not covered sufficiently by this instruction, contact your local distributor or manufacturer as listed in the outdoor unit nameplate.

This kit will raise the unit a minimum of 1/2 inch above mounting pad.

Location:

1. Vibration Isolators should be used if unit location requires vibration isolation, place mounting pads under unit corners as illustrated in Figure 1, 2 or 3 depending on unit type.
2. When the outdoor unit is mounted on a roof, be sure the roof will support the unit's weight. Vibration isolation is recommended to prevent transmission of sound or vibration into the building structure.

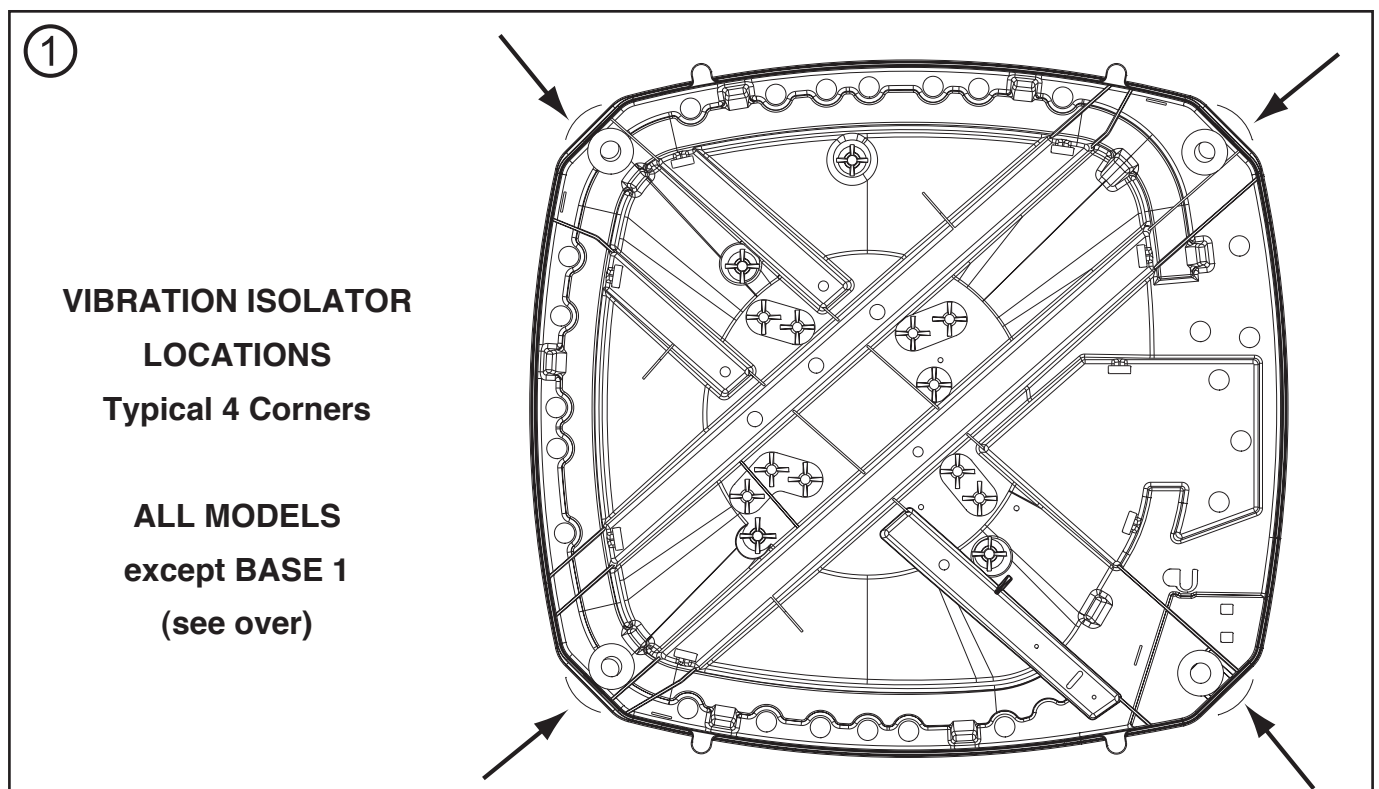

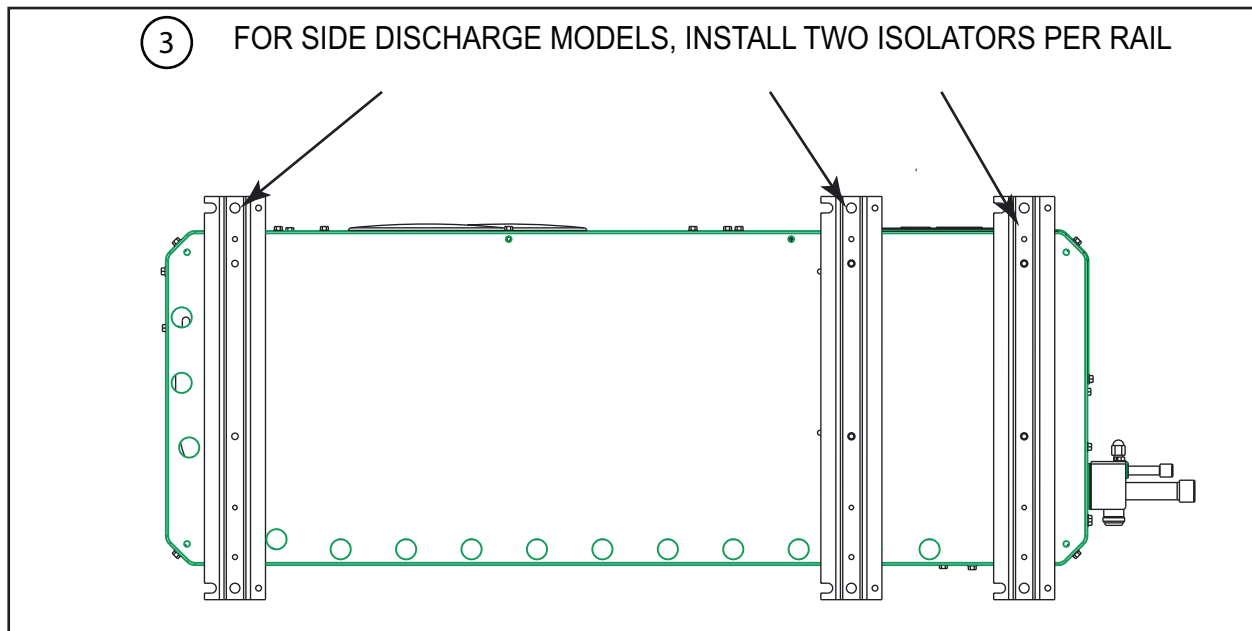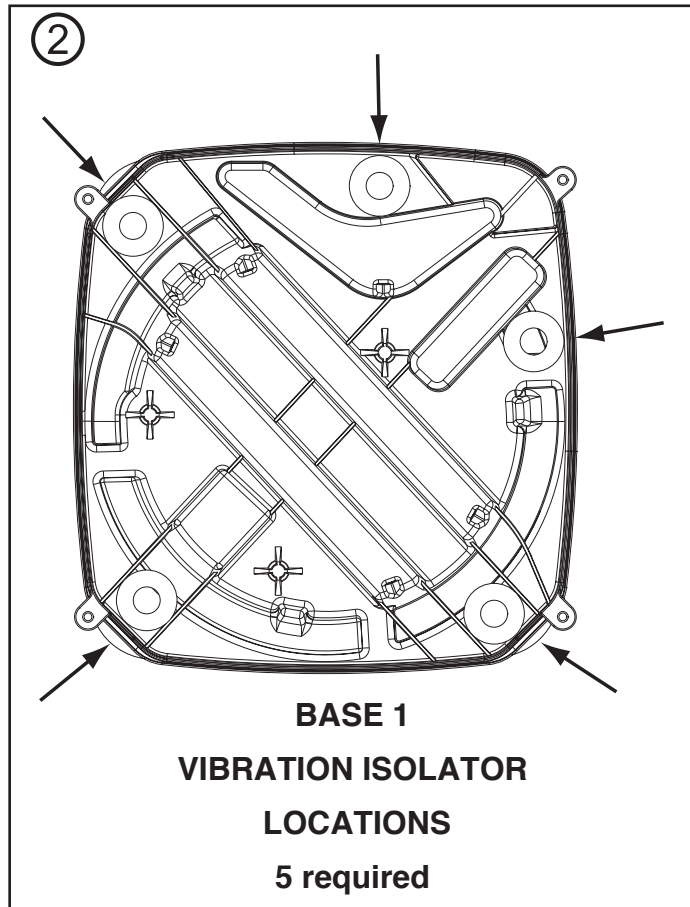

About Trane and American Standard Heating and Air Conditioning
Trane and American Standard create comfortable, energy efficient indoor environments for residential applications. For more information, please visit www.trane.com or www.americanstandardair.com

The manufacturer has a policy of continuous data improvement and it reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.