## 18-HE75D1-1B-EN

# **Installer's Guide**

### Extreme Condition Mounting Kit BAYEXMK003A for Slab Mounting – All Cabinet Sizes

### **AWARNING:** HAZARDOUS VOLTAGE – DISCONNECT POWER BEFORE SERVICING

ALL phases of this installation must comply with NATIONAL, STATE AND LOCAL CODES

**IMPORTANT**—This Document is **customer property** and is to remain with this unit. Please return to service information pack upon completion of work.

#### **Kit Contents**

Items	Quantity
Bracket-Hold Down (G90 Steel)	4
Self drilling #12-3/4" Screws	4

#### Inspection

Check carefully for any shipping damage. This must be reported to and claims made against the transportation company immediately. Any missing parts should be reported to your supplier at once, and replaced with authorized parts only.


#### Installation


Attach the (4) Base Brackets to the unit base using

 (4) of the #12 3/4" self drilling screws in the kit into
 an existing screw location on the unit. Install one (1)
 bracket on each side of the unit. Attach the brackets
 to the slab using (4) field provided bolts appropriate
 to the material the unit is mounted on (recommend a
 0.25" diameter bolt with a minimum of SAE-Grade 5
 (ASTM-A449) or better with appropriate washer).

# BAYEXMK003A

**REPLACE AFTER SERVICE** 

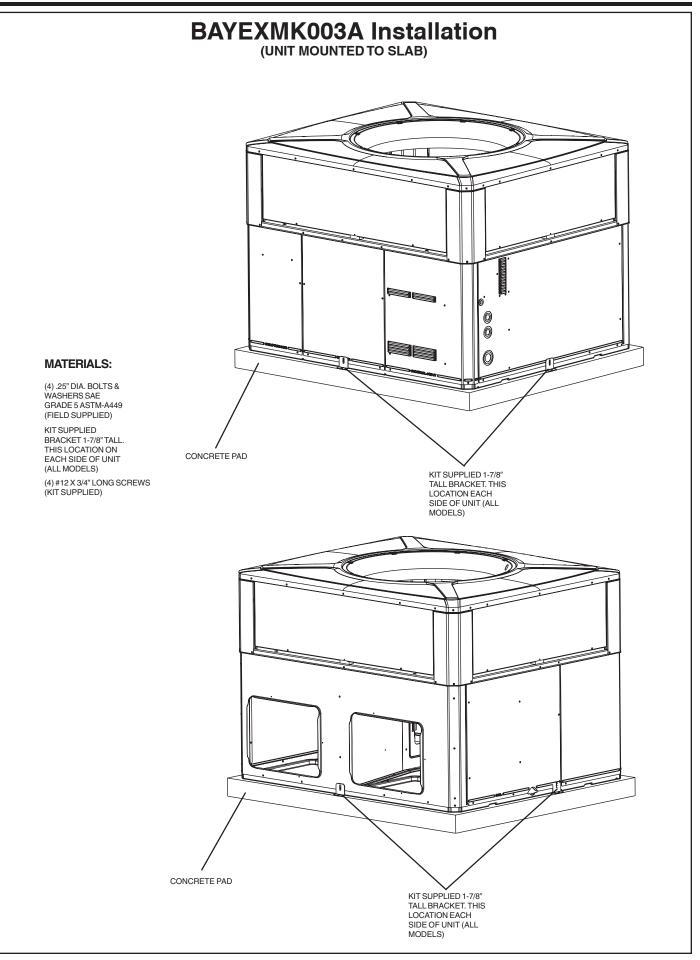

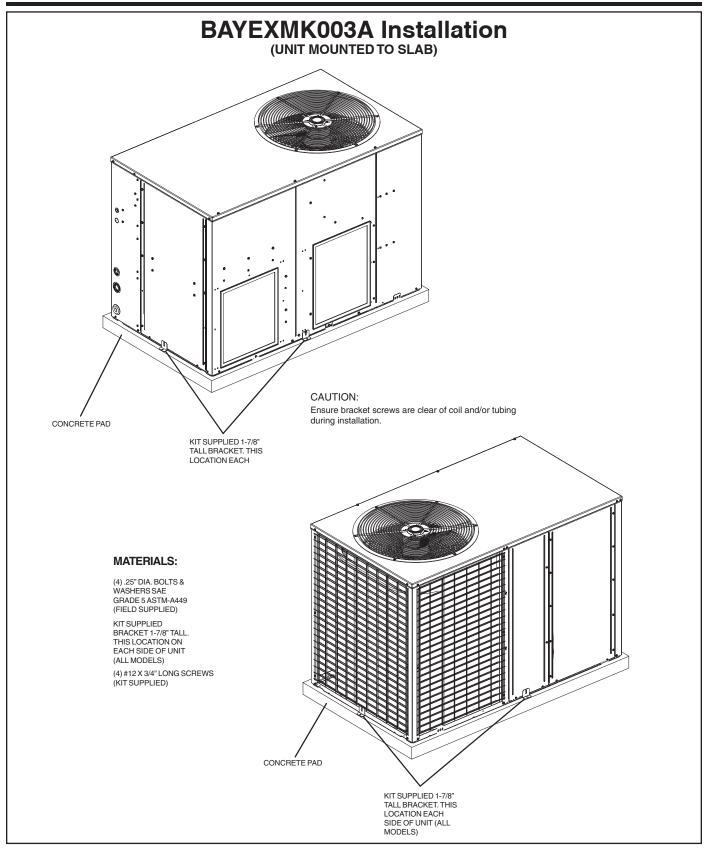

About Trane and American Standard Heating and Air Conditioning

Trane and American Standard create comfortable, energy efficient indoor environments for residential applications. For more information, please visit www.trane.com or www.americanstandardair.com

The manufacturer has a policy of continuous data improvement and it reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.