

# Installer's Guide

## Extreme Condition Mounting Kit BAYECMT003A for Impack Slab Mounting

**⚠ WARNING: HAZARDOUS VOLTAGE - DISCONNECT POWER BEFORE SERVICING**

**ALL phases of this installation must comply with NATIONAL, STATE AND LOCAL CODES**

**IMPORTANT** — This Document is **customer property** and is to remain with this unit. Please return to service information pack upon completion of work.

### **KIT CONTENT:**

Bracket-Hold Down\* and Label - Qty 4 (Height 1-7/8" for Impack and T/WCH048-60)

Bracket-Hold Down\* and Label - Qty 4 (Height 2-3/8" for T/WCH024-42 and TCK024-48)

\* G90 Steel

Self drilling 12-14 Screws - Qty 8

### **INSPECTION:**

Check carefully for any shipping damage. This must be reported to and claims made against the transportation company immediately. Any missing parts should be reported to your supplier at once and replaced with authorized parts only.

### **INSTALLATION:**

1. Attach the (4) Base Brackets to the unit base using (4) of the #12 3/4" self drilling screws in the kit into a existing screw location., locating them two to each long side of the unit *using (4) field provided bolts appropriate to the material the unit is mounted on* ( recommend a 0.25" diameter bolt with a minimum of SAE-Grade 5 (ASTM-A449) or better with appropriate washer). See figures 1,2,3.

**BAYECMT003A**


**REPLACE AFTER SERVICE**

D671117P01

1

## BAYECMT003A INSTALLATION UNIT TO CONCRETE PAD APPLICATION

ALL IMPACK MODELS (DCY, TCC, TCM, TCP, TCX, TCY, WCM, WCC, WCP, WCX, WCY, WCZ, YCC, YCP, YCX, YCY AND YCZ)

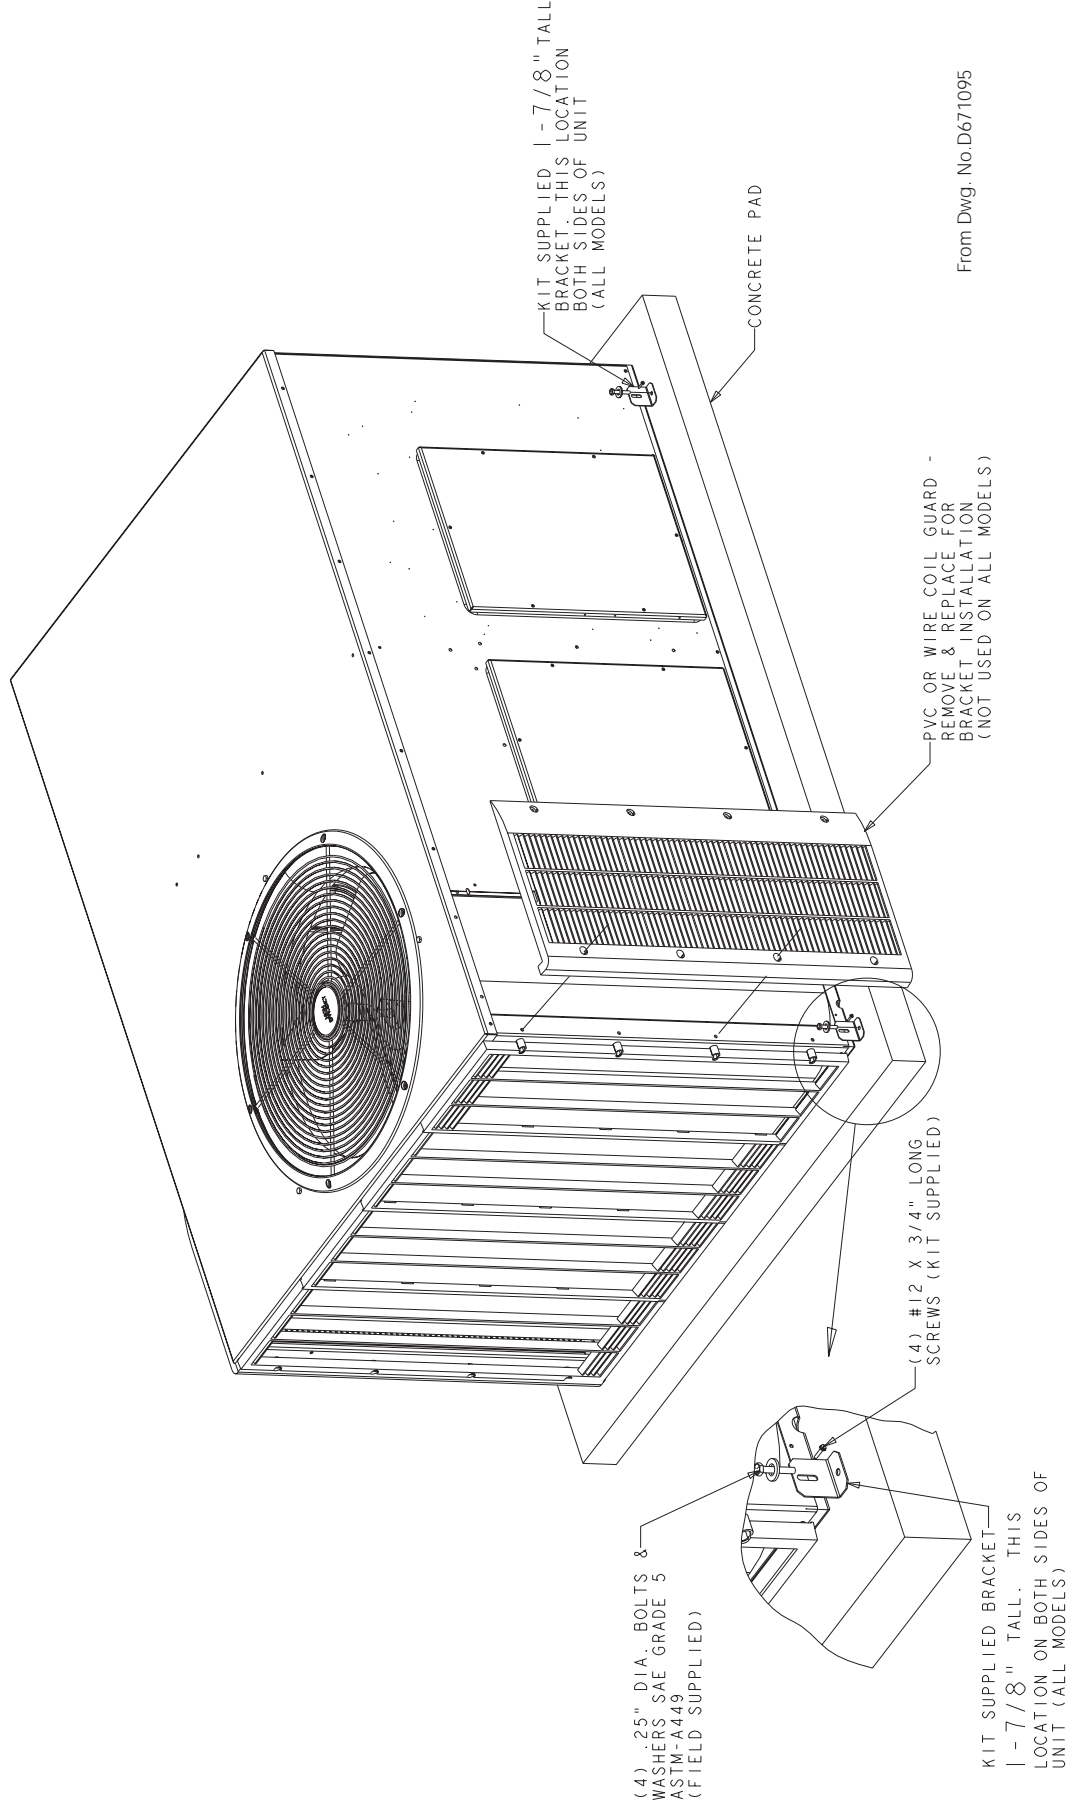

From Dwg. No.D671095


2

## BAYECMT003A INSTALLATION


(UNIT TO CONCRETE PAD APPLICATION)

TCH/WCH024, 030, 036, 042B MODELS

TCK024, 030, 036, 042, 048A MODELS

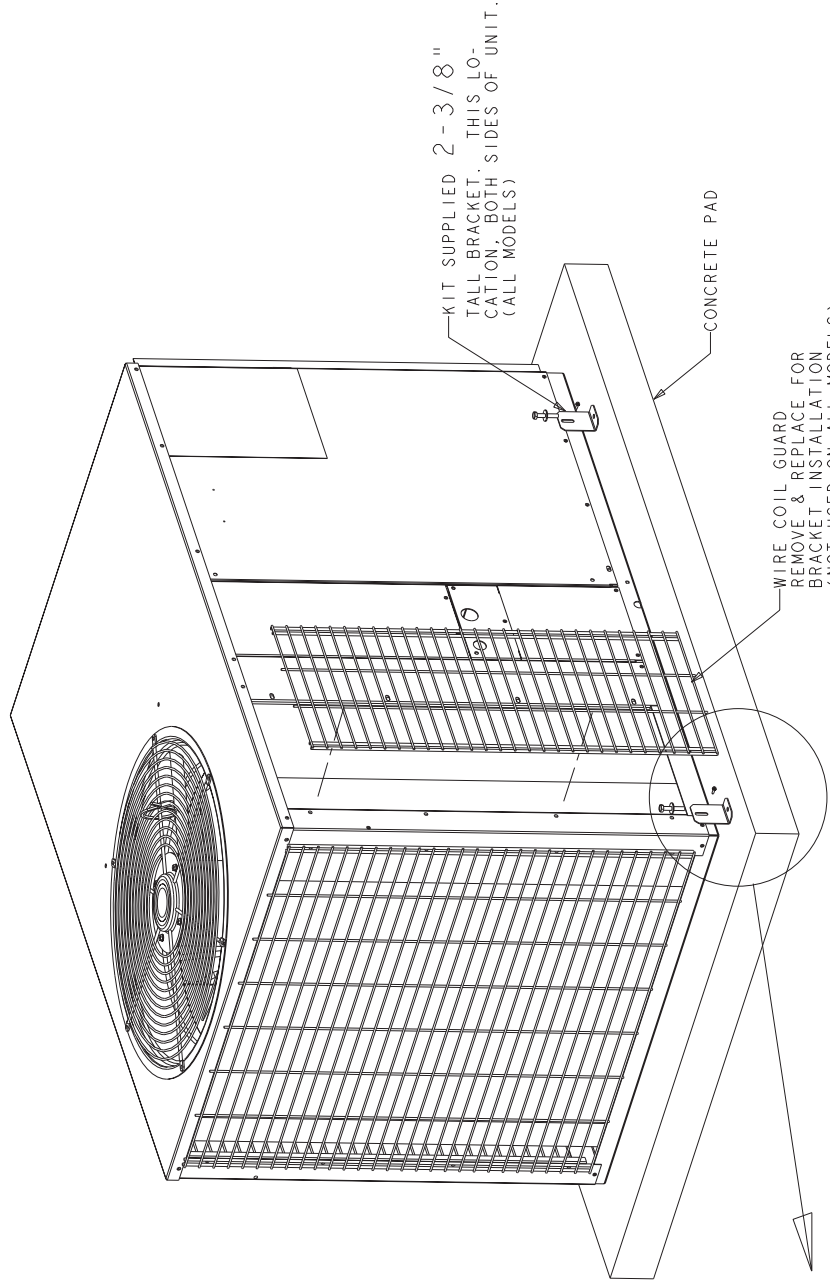

(4) .25" DIA. BOLTS & WASHERS SAE GRADE 5 ASTM-A449 (FIELD SUPPLIED)

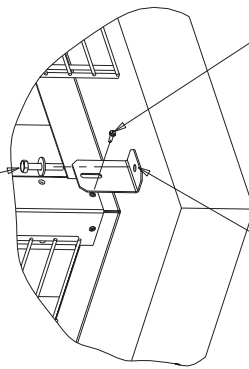

(4) #12 X 3/4" LONG SCREWS (KIT SUPPLIED)

KIT SUPPLIED BRACKET 2 - 3/8" TALL, THIS LOCATION ON BOTH SIDES OF UNIT (ALL MODELS)

From Dwg. No. D671097


# Installer's Guide

3

## BAYECMT003A INSTALLATION

(UNIT TO CONCRETE PAD APPLICATION)

TCH/WCH048,060F MODELS

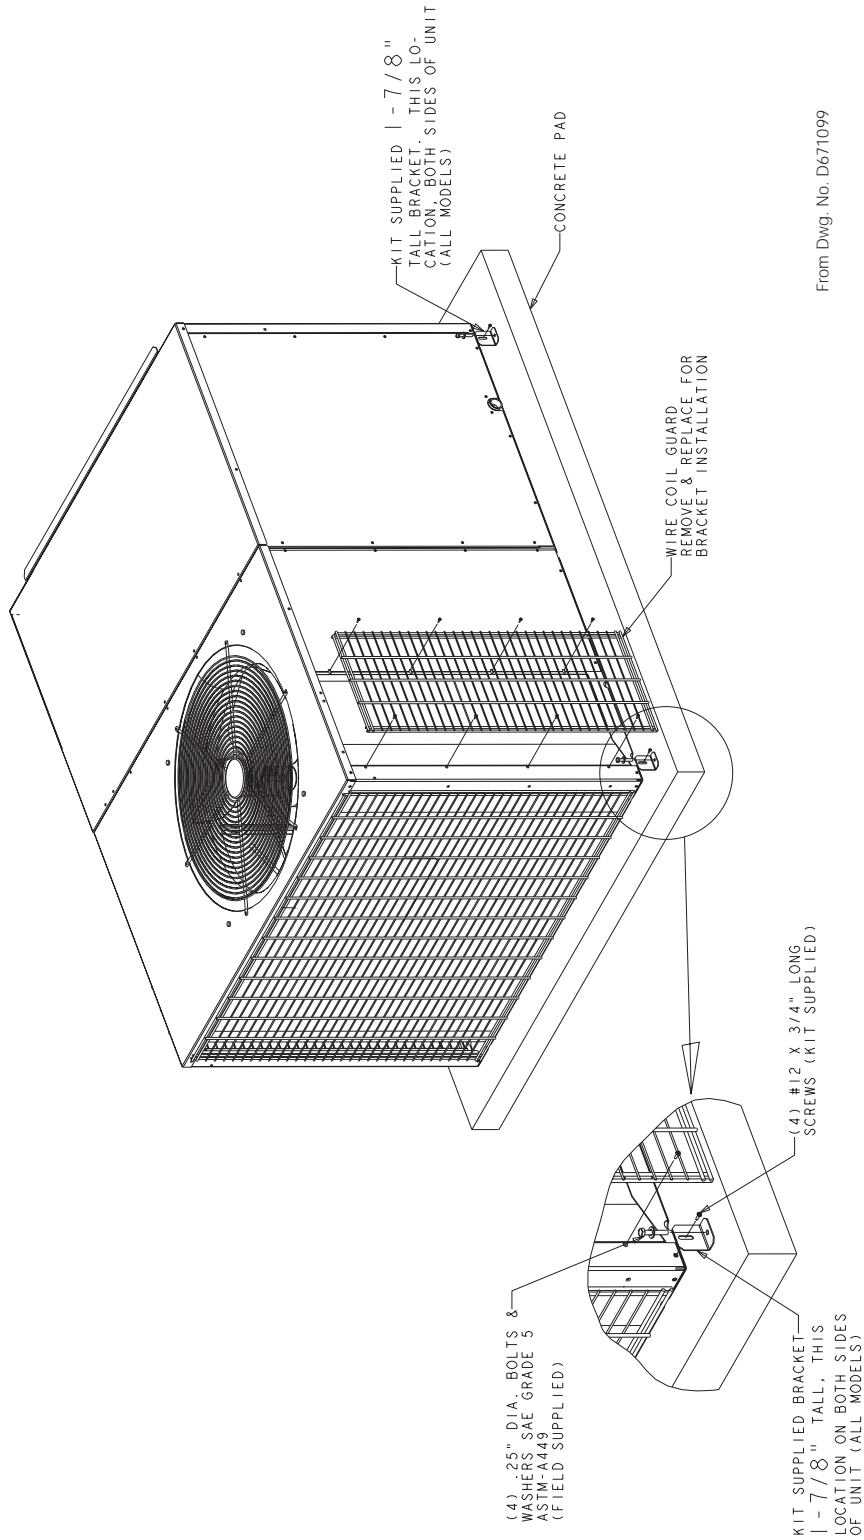

From Dwg. No. D671099

Trane  
A business of American Standard Companies

For more information contact  
your local dealer (distributor)

Since the manufacturer has a policy of continuous product and product data improvement, it reserves the right to change design and specifications without notice.

CM 03/04