




Installation

Tracer™ AH.540 and AH.541 Replacement

BRD02962 Replaces BRD02814

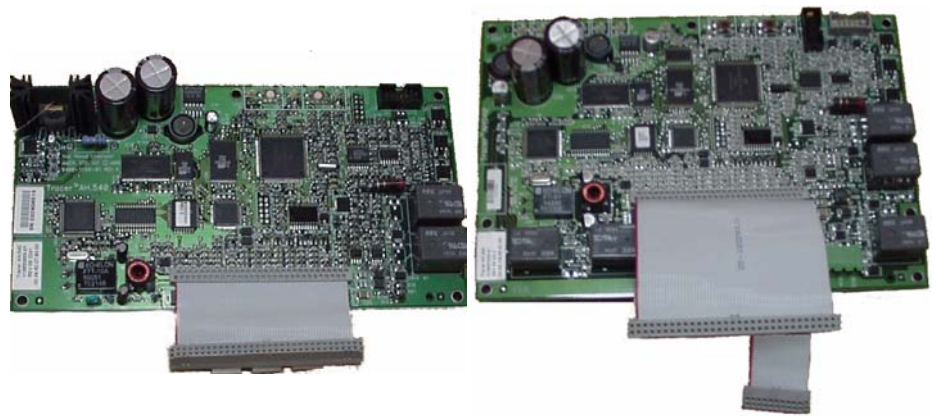

BRD02814

BRD02962

Models: BRD02962, BRD02814, Tracer AH540, Tracer AH541

Installation

Warnings and Cautions

NOTICE:

Warnings and Cautions appear at appropriate sections throughout this manual. Read these carefully.

⚠ WARNING -Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.

⚠ CAUTION -Indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury. It may also be used to alert against unsafe practices.

CAUTION -Indicates a situation that may result in equipment or property-damage-only accidents.

⚠ WARNING

Hazardous Voltage!

Disconnect all electric power, including remote disconnects before servicing. Follow proper lockout/tagout procedures to ensure the power can not be inadvertently energized. Failure to disconnect power before servicing could result in death or serious injury.

Installation Instructions

When replacing a version 1.0 or 1.5 board (BRD02814, X13650859-01 or equivalent), you will notice that this new board (BRD02962) is physically different. It is functionally the same. The boards use the same mounting holes and connections. The new one has two connectors; both should be connected to the termination board. This board has additional outputs that are not used if you are replacing a version 1.0/1.5 board.

The new board will be recognized by the Rover Service Tool as a version 2 device. Setup and configuration will be similar to that of the old board. If Rover does not recognize this board, you will need to obtain Rover V5.0 with service pack 2 or higher. Also, version 1 RCF (Rover Configuration File) is not compatible with the version 2 hardware - the board will have to be configured using the Rover configuration screen.



Trane

A business of American Standard Companies
www.trane.com

For more information, contact your local district office or e-mail us at comfort@trane.com

Literature Order Number	PART-SVN84A-EN
File Number	SV-SP-Controls-PART-SVN84A-EN-0404
Supersedes	New
Stocking Location	Electronic Only

Trane has a policy of continuous product data and product improvement and reserves the right to change design and specifications without notice. Only qualified technicians should perform the installation and servicing of equipment referred to in this bulletin.